


GRAND STRAND WATER AND SEWER AUTHORITY

HWY 707/ HWY 17 BYPASS WATERLINE INTERTIE

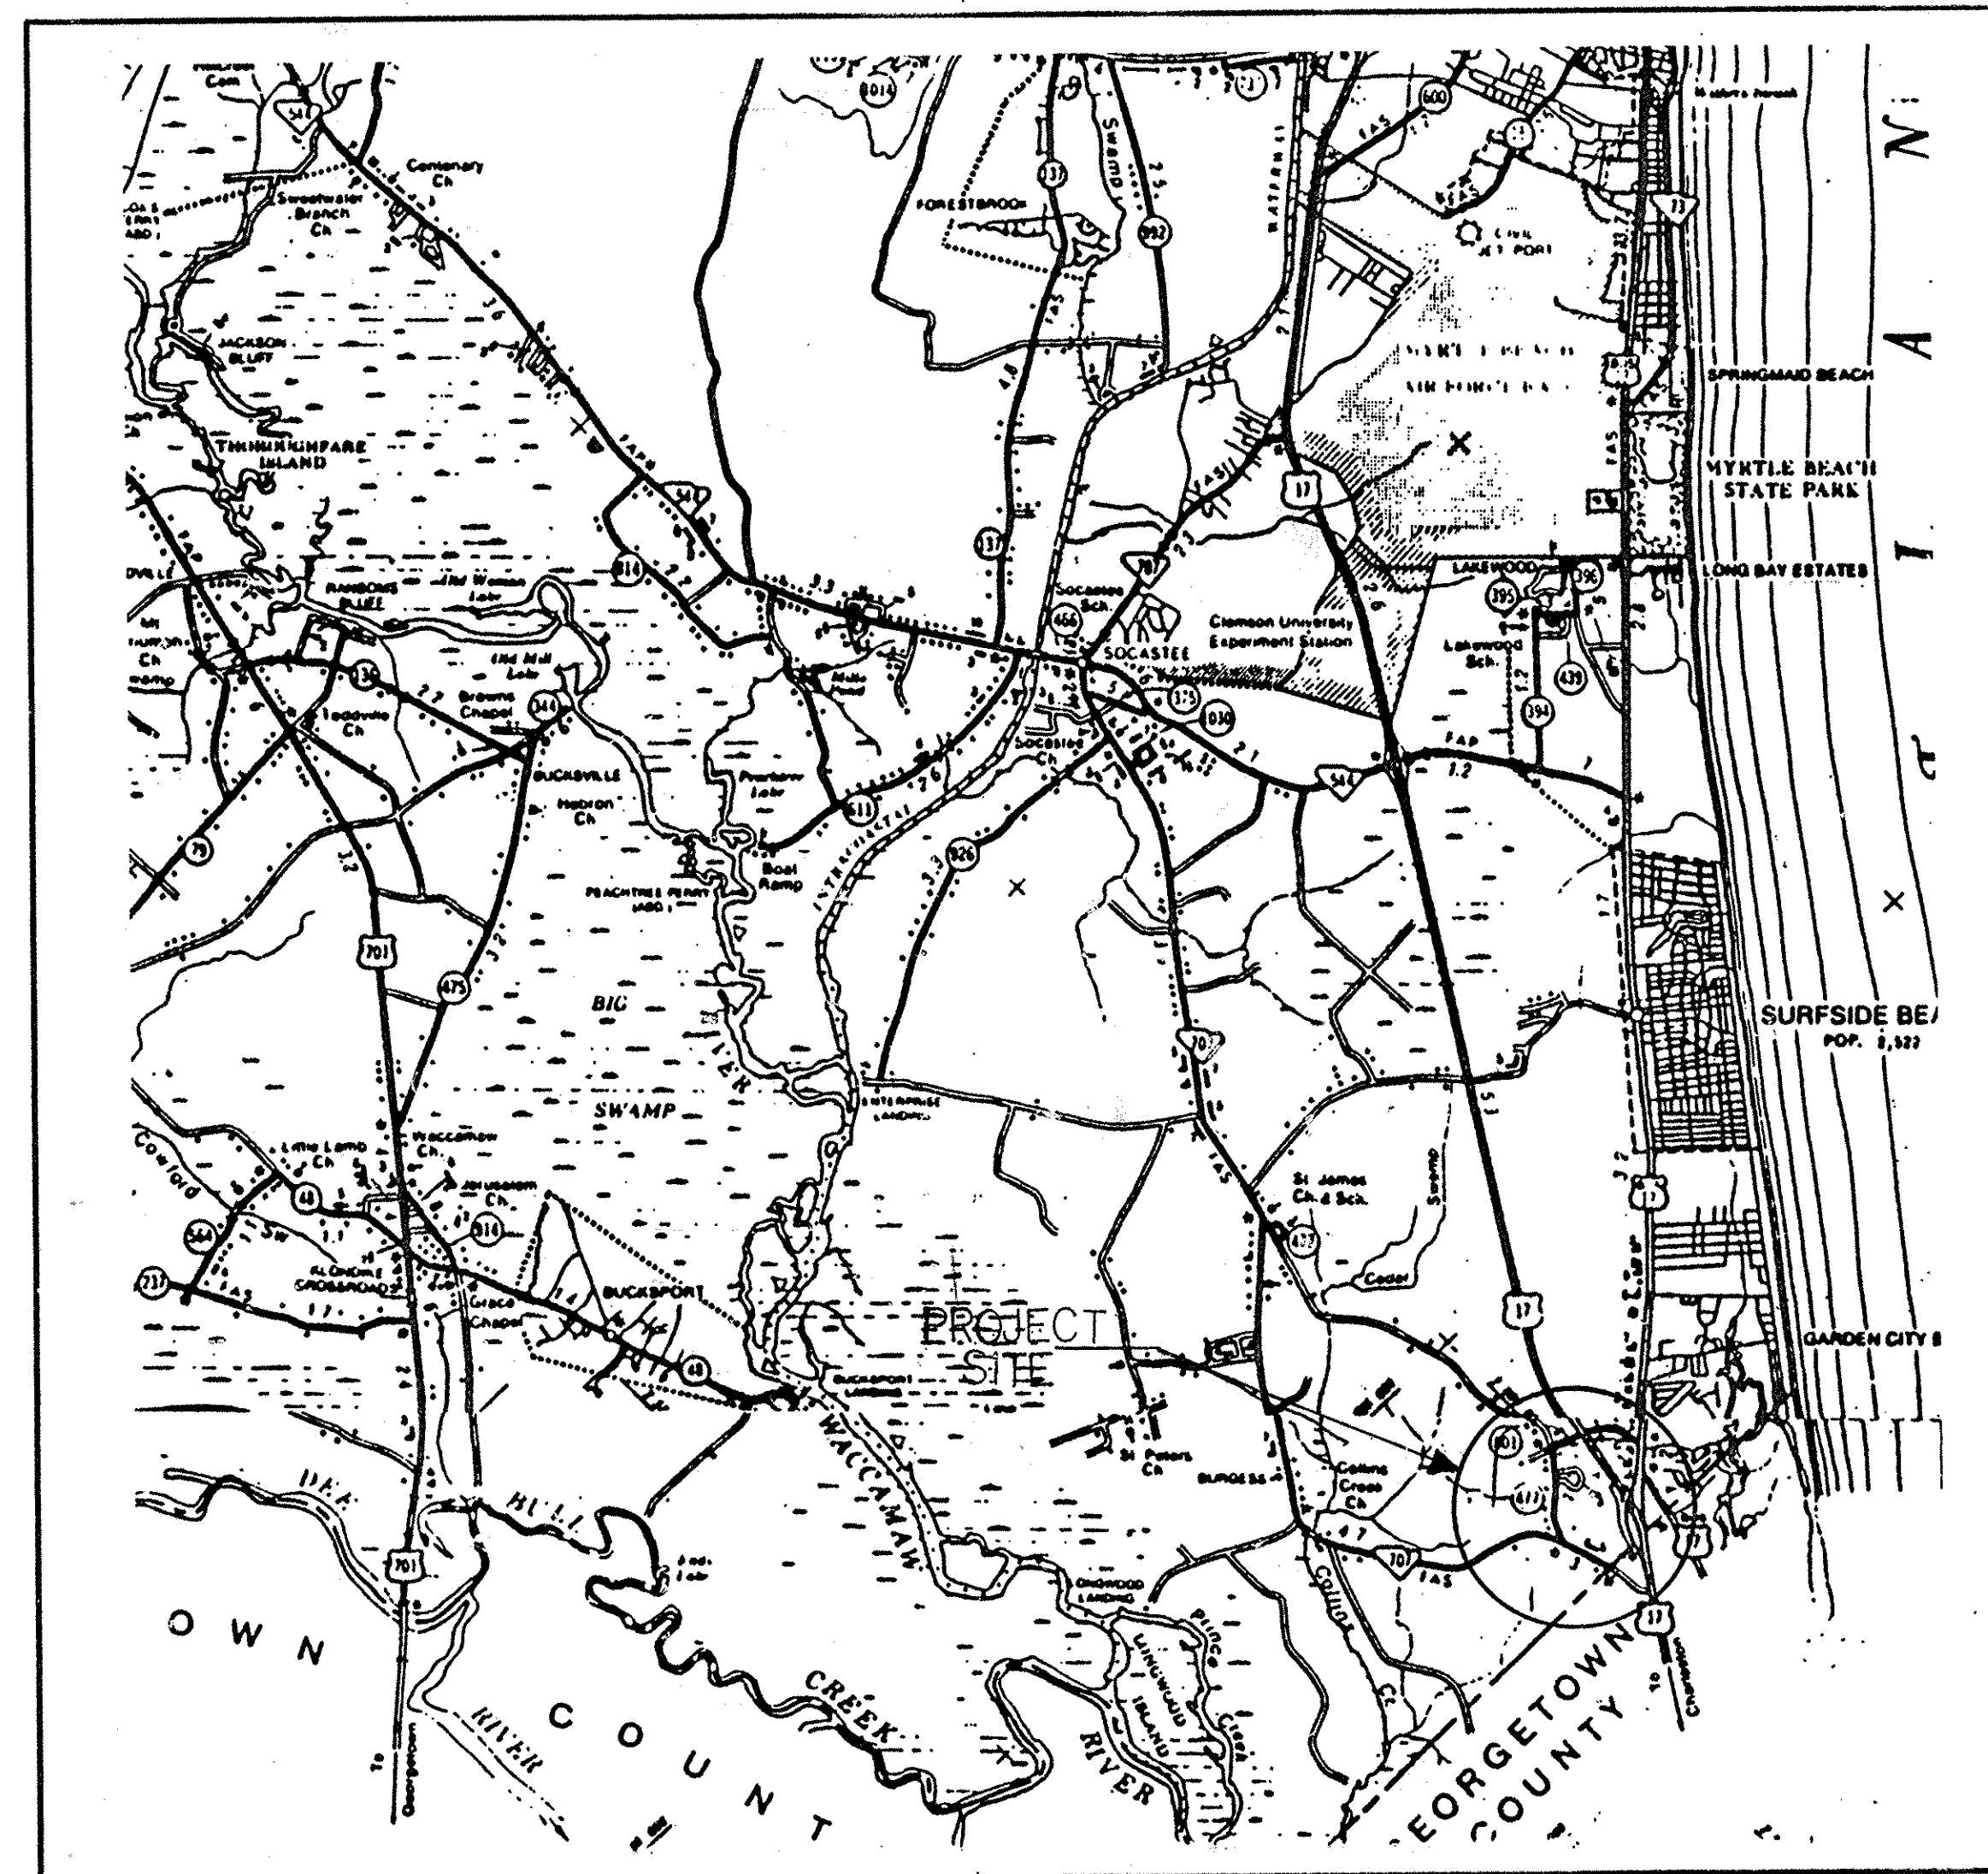

GENERAL NOTES:

1. ALL EXISTING DITCHES TO BE RECONSTRUCTED AS NECESSARY TO ALLOW PROPER PIPELINE INSTALLATION, CLEARANCE, AND DEPTH OF COVER
2. MINIMUM DEPTH OF COVER SHALL BE 36".
3. EXISTING LINES AND VALVES TO BE FIELD LOCATED BY CONTRACTOR.
4. CONTRACTOR TO VERIFY LOCATION OF ALL EXISTING UTILITIES BEFORE BEGINNING CONSTRUCTION. INFORMATION ON EXISTING UTILITIES SHOWN ON THE DRAWINGS IS FOR INFORMATIONAL PURPOSES ONLY, NO RESPONSIBILITY IS ASSUMED BY GSW&SA OR THE ENGINEER FOR THE ACCURACY OR COMPLETENESS OF THIS INFORMATION.
5. ALL MATERIAL, WORKMANSHIP, CONSTRUCTION AND TESTING SHALL CONFORM TO THE GSW&SA STANDARD PLANS AND SPECIFICATIONS.
6. DISTANCE BETWEEN MAIN LINE GATE VALVES ARE APPROXIMATE; LOCATION OF GATE VALVES TO BE DETERMINED BY GSW&SA.
7. THE GSW&SA WILL SECURE ALL NECESSARY ENCROACHMENT AND TRENCH PERMITS FROM APPLICABLE PUBLIC AGENCIES.
8. NO CONSTRUCTION SHALL COMMENCE WITHOUT PRIOR APPROVAL OF THE GSW&SA.


PREPARED BY:

GRAND STRAND WATER AND SEWER AUTHORITY

P.O. BOX 1537 CONWAY, SC 29526

APPROVED BY:

Fred R. Richardson
FRED R. RICHARDSON P.E. # 9853

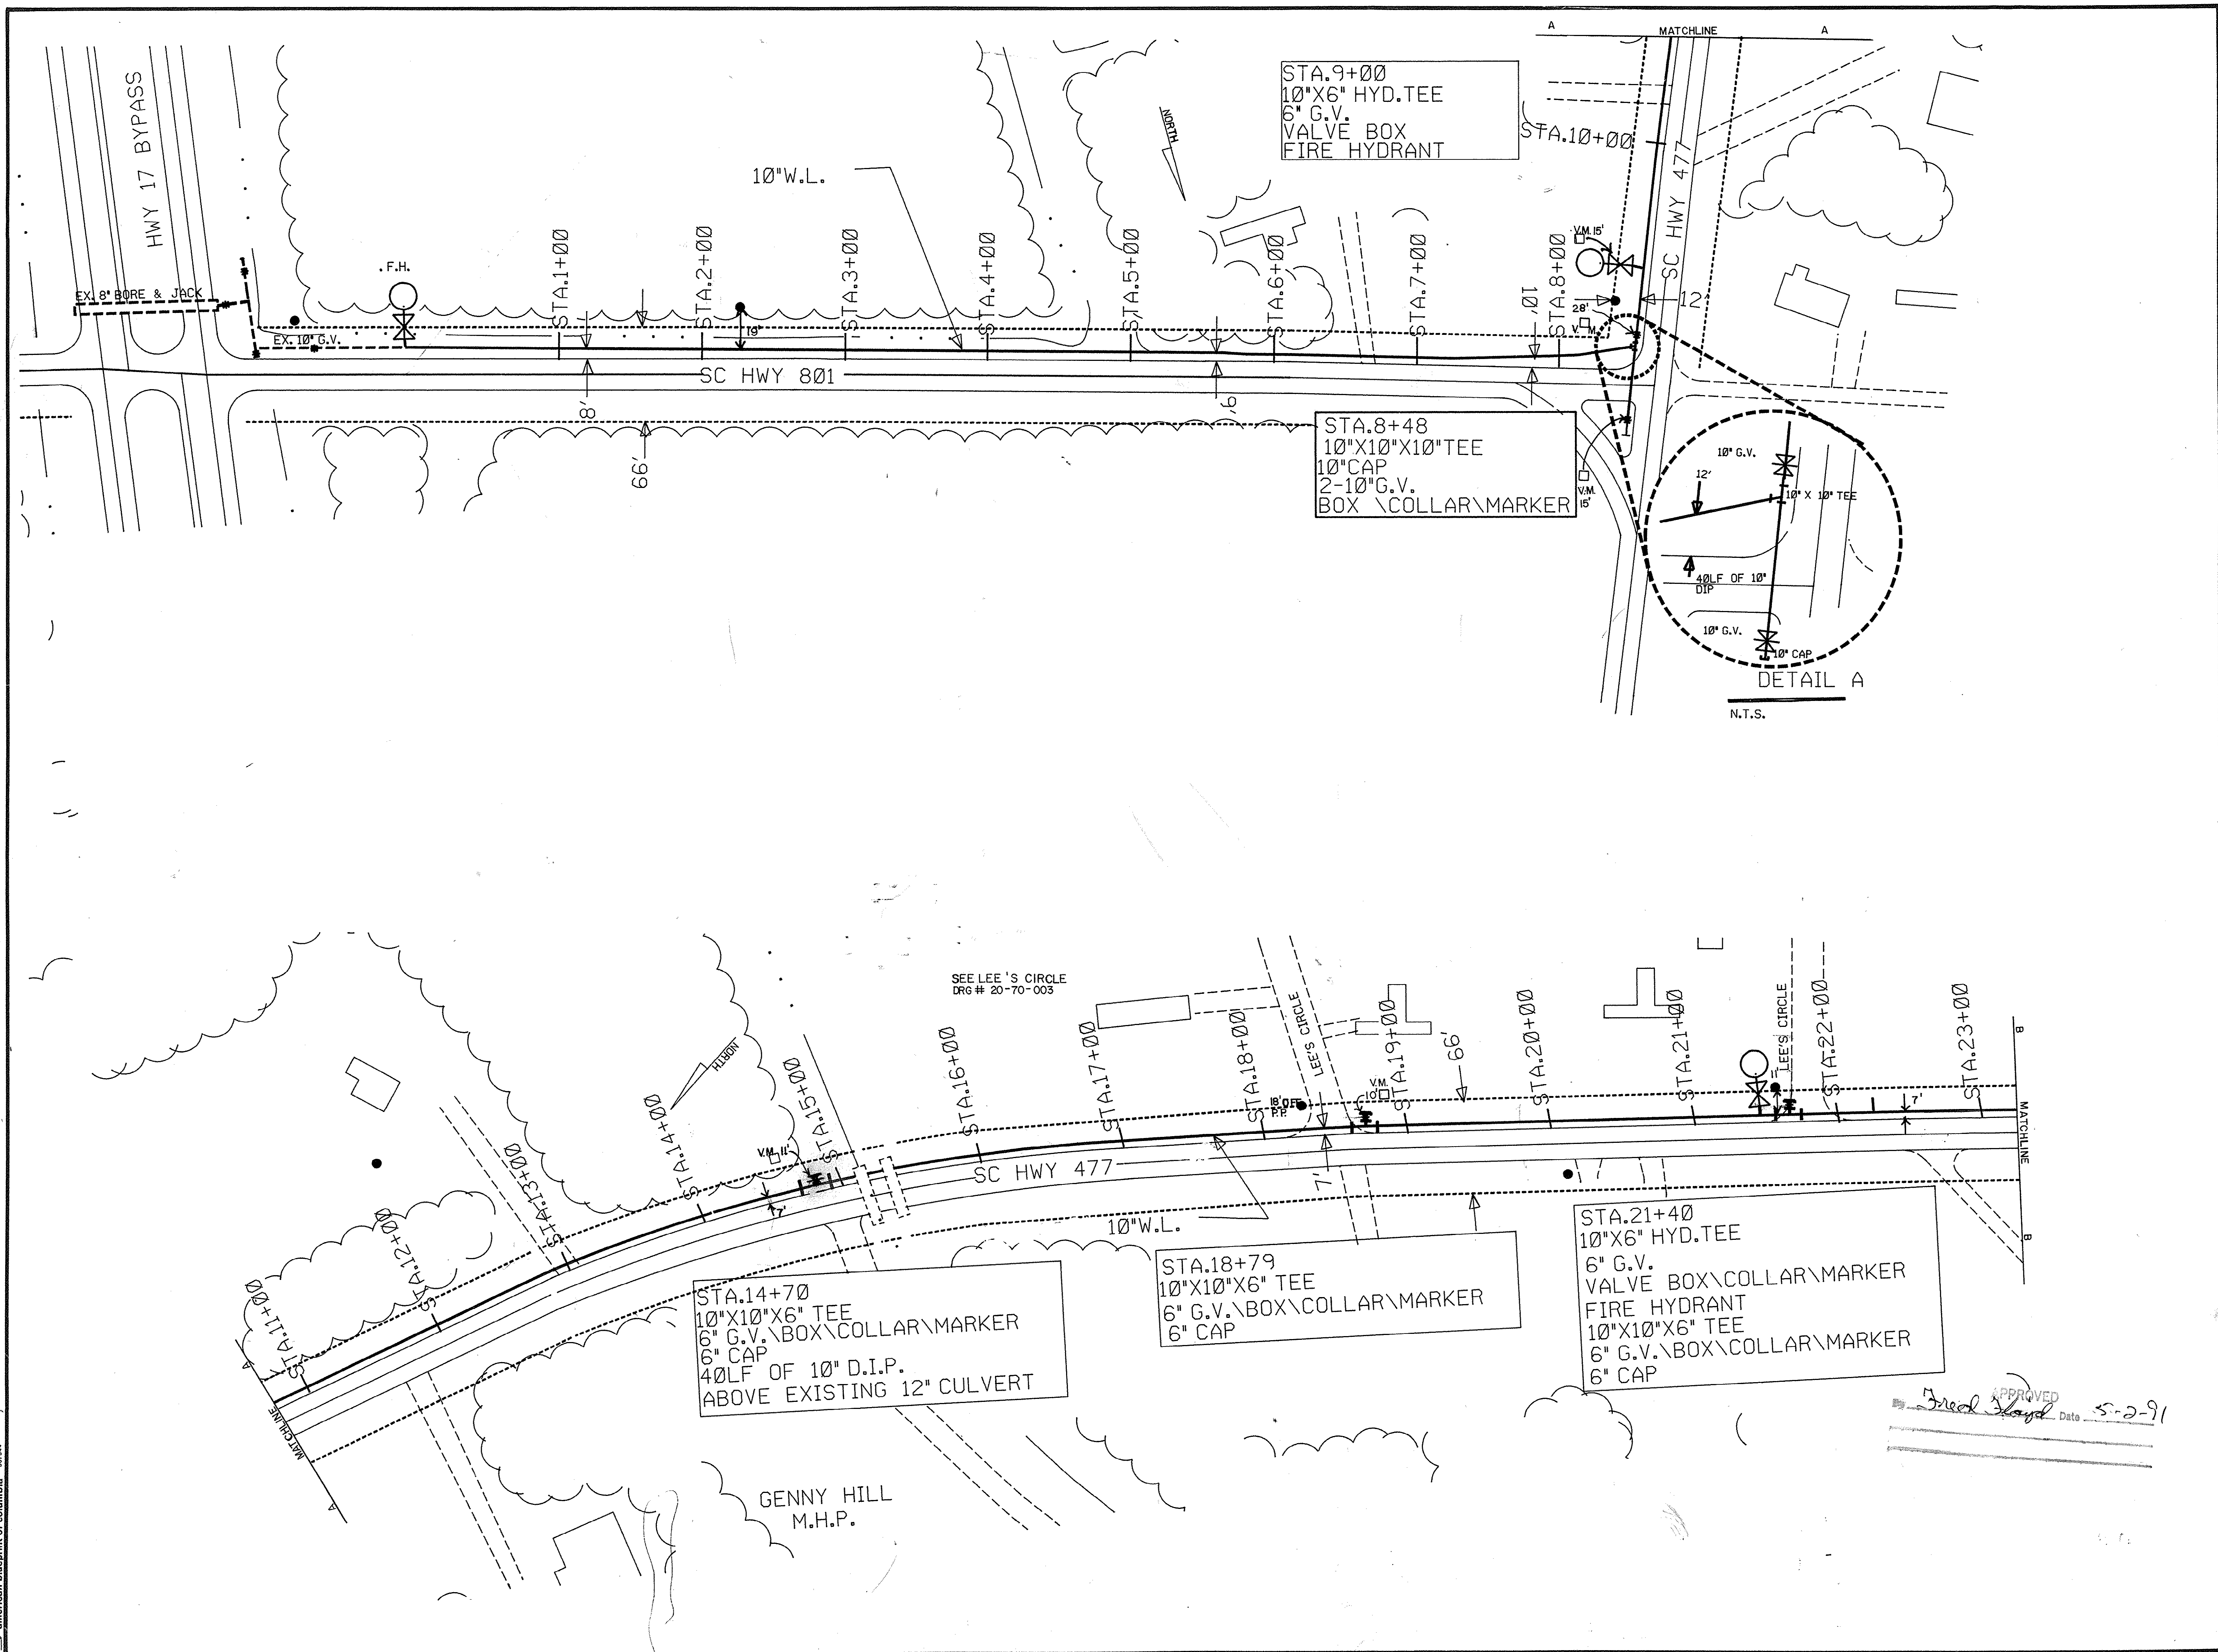

REVISION	BY	DATE


HWY 707 / HWY 17 BYPASS

WATERLINE INTERTIE

GRAND STRAND WATER & SEWER AUTHORITY

P.O. BOX 1537, CONWAY, S.C. 29526
TELEPHONE (803) 347-4641 OR 448-1686

DATE	1-11-91
SCALE	1" = 50'
DRAWN BY	K.M.M.
CHECKED BY	B.B.
APPROVED BY	FRED RICHARDSON P.E. NO. 9853
SHEET	2 OF 4
DRAWING NO.	20-66-002-W

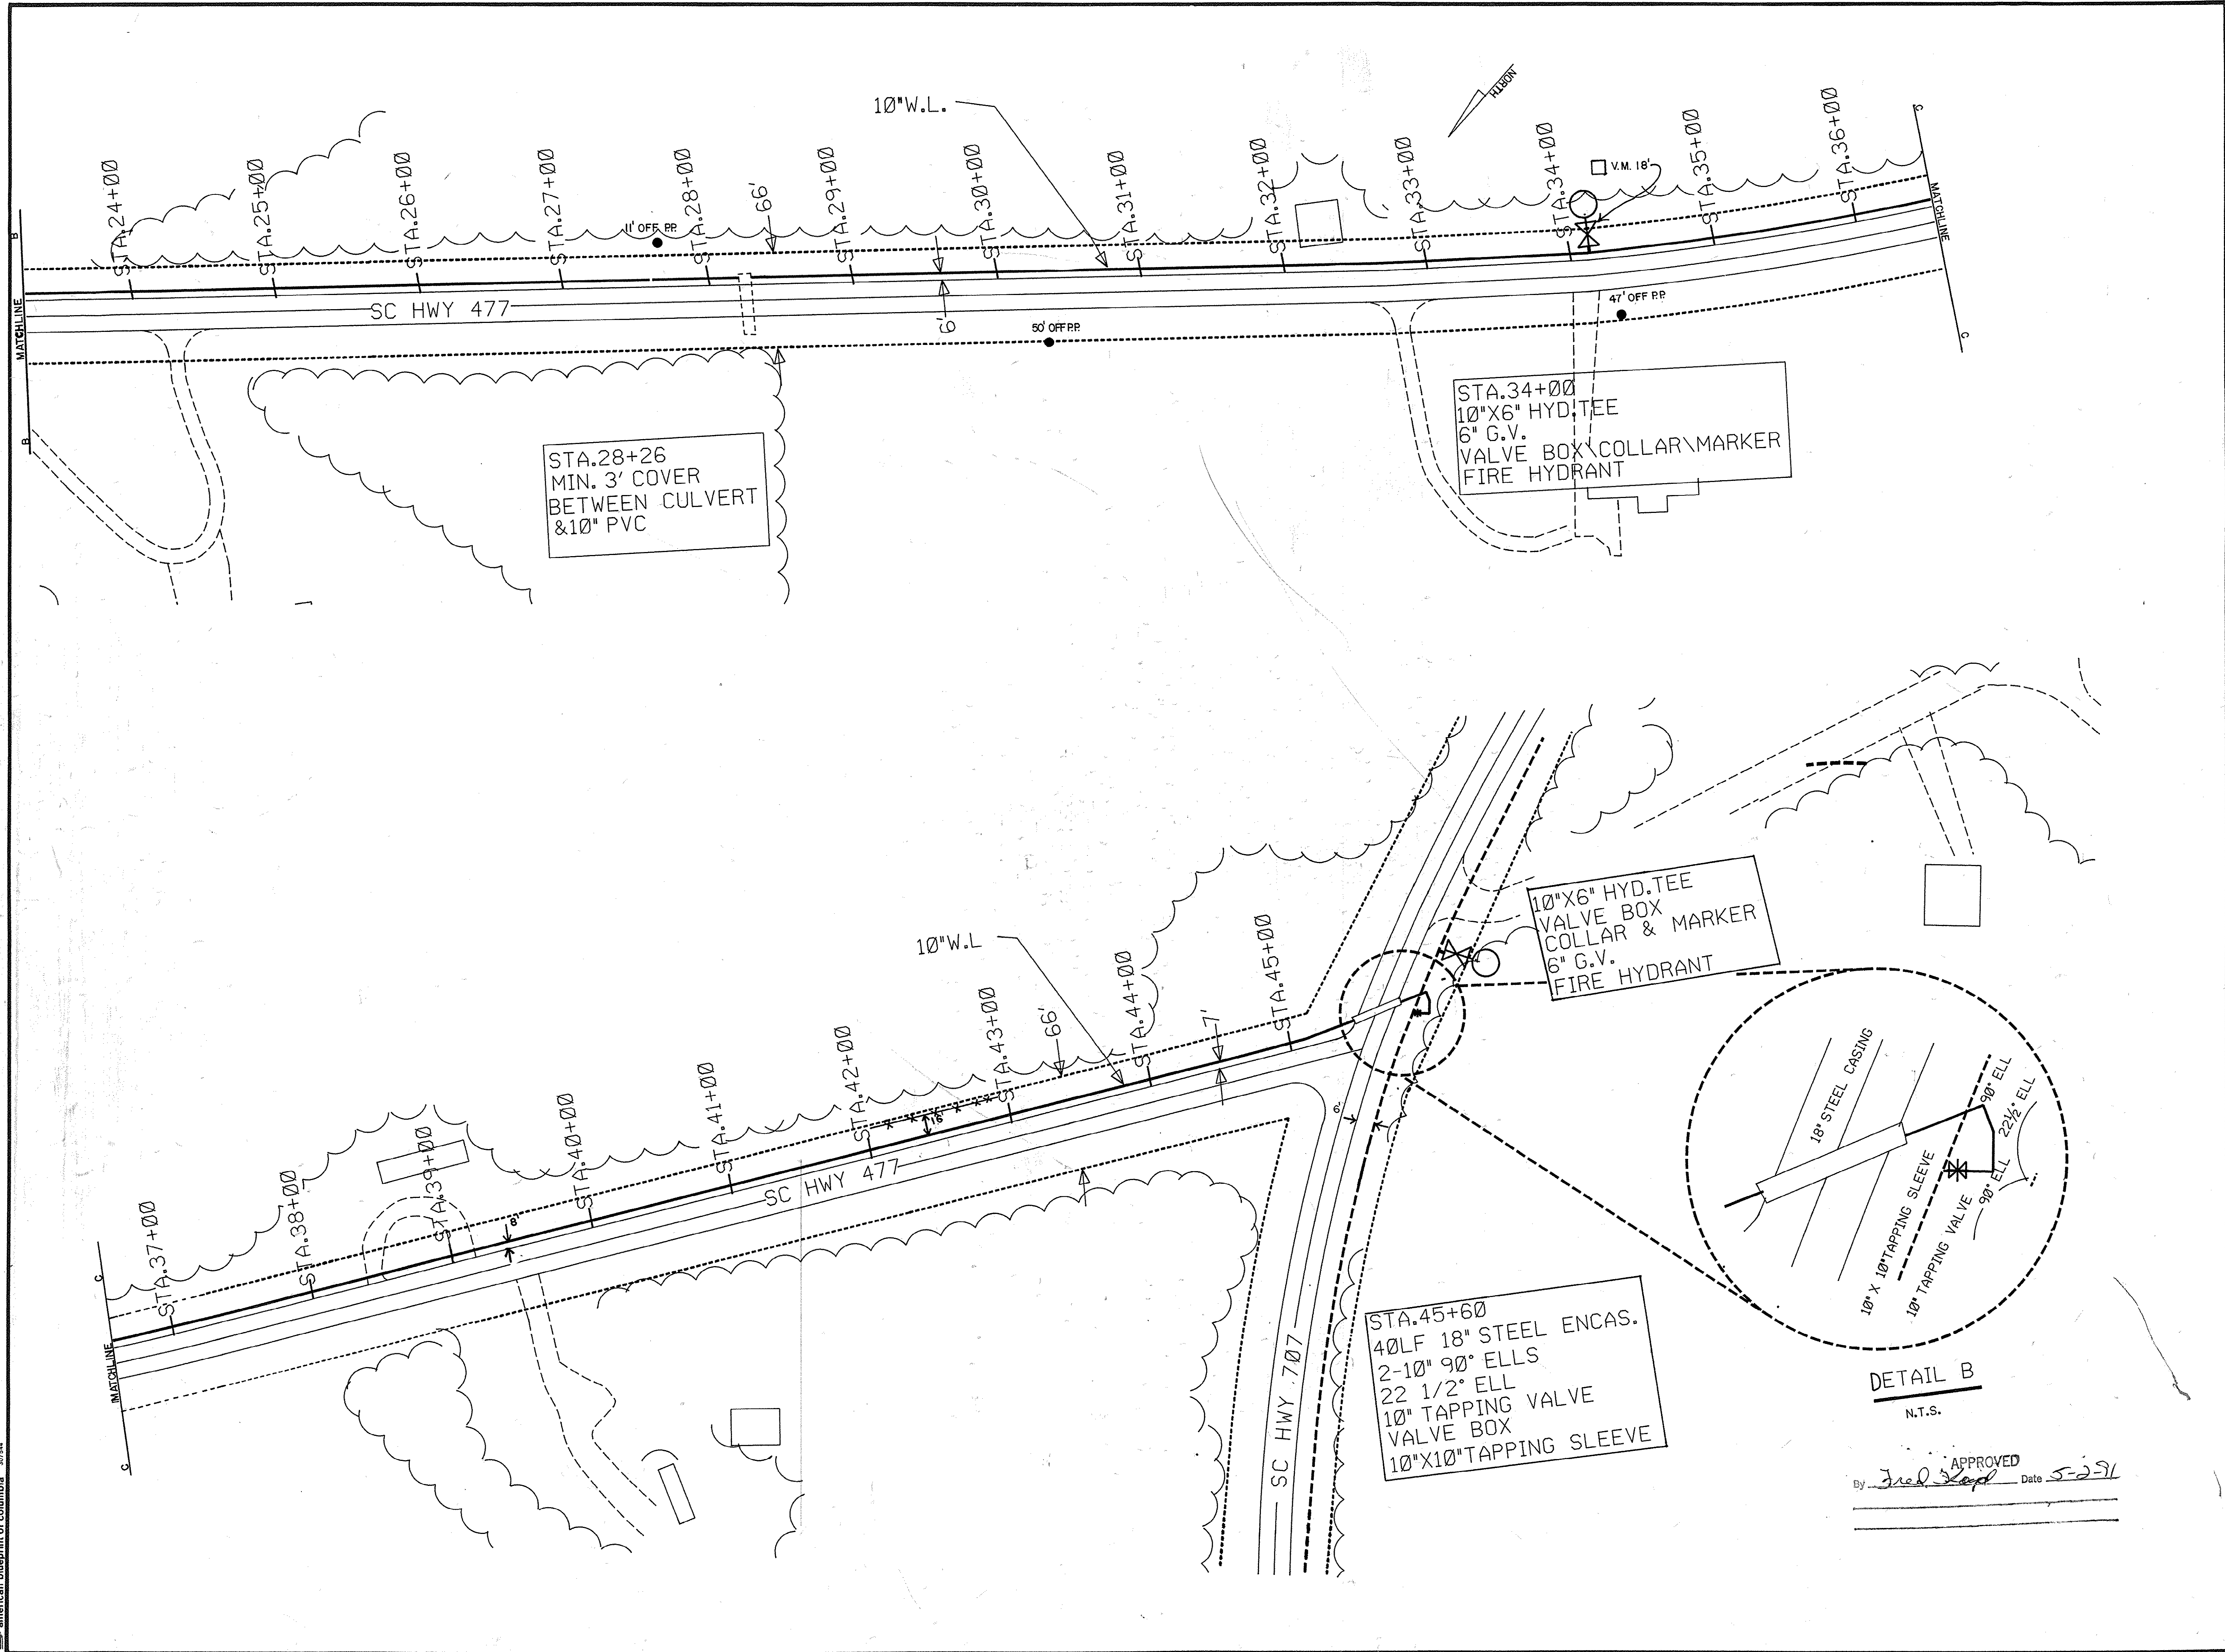

REVISION		BY	DATE

HWY 707 / HWY 17 BYPASS

WATERLINE INTERTIE

GRAND STRAND WATER & SEWER AUTHORITY

P.O. BOX 1537, CONWAY, S.C. 29526
TELEPHONE (803) 347-4641 OR 448-1686

DATE	1-11-91
SCALE	1" = 50'
DRAWN BY	K.M.M.
CHECKED BY	B.B.
APPROVED BY	
FRED RICHARDSON P.E. NO. 9853	
SHEET 3 OF 4	
DRAWING NO. 20-66-003-w	

